


**State of West Virginia  
Source Water Assessment and  
Protection Program  
Source Water Assessment Report**

**Mingo County PSD - Naugatuck  
Mingo County  
PWSID: WV3303029**

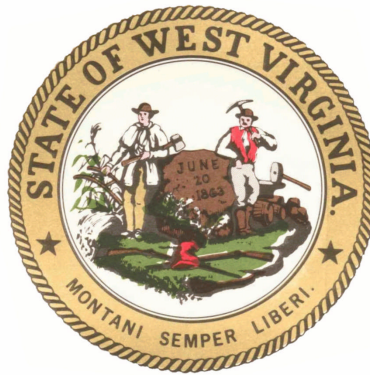

**Prepared by:**

**West Virginia Department of Health and Human Resources  
Bureau for Public Health  
Office of Environmental Health Services  
Source Water Protection Unit**

**Date: September 2004**

**Surface Water Public Water Supply Systems  
Source Water Assessment and Protection Program (SWAPP)  
Susceptibility Report**

Prepared by the  
West Virginia Bureau for  
Public Health, Source  
Water Assessment and  
Protection Unit

Date Prepared: Tuesday,  
September 7, 2004

**What is the Purpose of a Susceptibility Report?**

A susceptibility report identifies the most significant potential contaminant sources that could threaten the quality of your public water supply. Your susceptibility ranking does not imply poor water quality. Regular water tests best reflect actual water quality. This report will be used by public water supply systems with a surface water source. In addition, this report will enhance West Virginia's existing watershed approach to water quality improvement and protection. Table 1 provides you information on your public water supply.

**What is SWAPP?**

The SWAPP, established under the Safe Drinking Water Act, requires every state to:

- inventory land uses within the recharge areas of all public water supplies;
- assess the susceptibility of drinking water sources to contamination from these land uses; and
- publicize the results to provide support for improved protection of sources.

Table 1: Public Water Supply (PWS) Information

PWS Name	Mingo County PSD – Naugatuck
PWS Address	P O Box 98 Naugatuck, WV 25685
PWS ID Number	WV3303029
County	Mingo
System Type	Community

The West Virginia Bureau for Public Health (BPH) is undertaking this task. The rankings of susceptibility of your intake (s) to potential contamination are listed in Table 2.

Table 2: Intake Information

Facility Name	Source Name	Design Meets Regulations	Susceptibility Ranking
Mingo County PSD-Naugatuck	Tug Fork	Yes	High

The BPH Central Office assessed the source, Mingo County PSD-Naugatuck. A file review and field survey were used to conduct the assessment.

**What is my Source Water Protection Area (SWPA)?**

Unlike ground water aquifers, which have a natural protective layer above them, all surface waters are susceptible to contamination because they are exposed at the surface and lack a protective barrier from contamination. Accidental spills, releases, sudden precipitation events that result in overland runoff, or storm sewer discharges can allow pollutants to readily enter the source water and potentially contaminant the drinking water at the intake. Because of this, the SWPA consists of two types of

delineations.

- **Watershed Delineation Area**

The first type of delineation is the Watershed Delineation Area (WSDA). Figure 1 shows the extent of the WSDA, which covers approximately 1,031 square miles in the Tug Fork Watershed. The WSDA includes the entire watershed area upstream of the intake, and includes waters from the State of West Virginia and the State of Kentucky. The perimeter of the catchment area provides the water to the water supply intake.

- **Zone of Critical Concern**

The second type of delineation is the Zone of Critical Concern (ZCC). Figure 2 shows the ZCC area, which covers approximately 3,388 acres. The ZCC is a corridor along streams within the WSDA area that warrants a more detailed inventory and management due to its proximity to the surface intake and to the susceptibility to potential contaminants. The ZCC is calculated using a mathematical model that accounts for stream flows, gradient, and area topography. The length of the ZCC is based on a five hour time of travel. The ZCC width is 1,000 feet from each bank of the principal stream and 500 feet from each bank of the tributaries draining into the principal stream.

## **What is Susceptibility?**

Susceptibility is a measure of your intake's potential for contamination from land uses and activities within the SWPA at concentrations that pose a concern. The purpose of the susceptibility analysis is to provide a pointer to what action a public water system should take to further define and reduce susceptibility. This may include recommendations for a more detailed inventory and assessment, monitoring work, or an indication of the type and intensity of source water and other protection activities needed.

The possibility of a release from potential contaminant sources is greatly reduced if best management practices (BMP's) are used. However, the susceptibility determination for your intake did not take into account whether BMP's are being used.

Susceptibility of a drinking water intake does not mean a customer will drink contaminated water. Water Suppliers protect drinking water by monitoring and treating water supplies, and using BMP's and source water protection measures to ensure that safe water is delivered to the tap.

## **How Was The Water Supply Susceptibility Determined?**

Your intake (s) susceptibility is based on the following:

### **Resource Characterization**

The purpose for conducting the Resource Characterization analysis of the delineated SWPA is to obtain an understanding of its physical, biological, chemical, and hydrological characteristics. Four resource characteristics were evaluated:

- The potential for surface runoff to occur;
- The ease that surface runoff transport material can be delivered into the stream;

- The movement through the SWAP area; and
- The biological and chemical health of the surface water resource in the SWAP area.

- **Potential for Surface Runoff to Occur**

The soil types present in the watershed area and the associated soil properties have a direct influence on the potential for surface runoff to occur. As infiltration rate of soil increases, (more precipitation soaking in rather than running off) the contaminant load associated with the reduced runoff should decrease. Table 3 provides a summary of the associated soil groups.

Table 3: Summary of Soil Associations in the WSDA\*

Soil Associations	Soil Drainage	Topographic Setting
Matewan-Highsplint-Guyandotte	Well drained	Very steep
Pineville-Berks	Well drained	Very steep
Urbanland-Udorthents-Chavies	Well drained	Nearly level to gently sloping
Pineville-Berks	Well drained	Moderately steep to extremely steep
Kaymine-Cedarcreek-Pineville	Well drained	Gently sloping to very steep

\*This information is limited to the WSDA within the state boundaries of West Virginia.

- **Ease of movement of material into the Stream System (Rate of Overland Material Transport):**

The size, shape, and slope of the SWAP area have a direct influence on material transported by surface runoff. In general, the longer the overland travel distance and travel time that surface runoff has taken in order to reach a stream channel, the greater the chance it has to deposit and filtrate the contaminants that may occur. Table 4 provides an analysis of the size, shape, and slope.

Table 4: Hydrologic Setting

Size of WSDA Area (mi <sup>2</sup> )	1,031
Shape of WSDA Area	Long and Narrow
Stream Length (Main Stem) (mi)	115
Average Watershed Slope	10 to 30 %

- **Movement of Water through the Watershed Area**

A number of physical and natural factors can influence the movement of water through the SWAP area. The pattern and development of the drainage network of the SWAP area directly influence the rate of water movement. Evaluation of the hydrologic cycle will provide an indication of the amount of annual rainfall that is absorbed into the ground or becomes runoff. Table 5 summarizes the total mileage of streams contained in the WSDA, average stream gradients of the main stem, average rainfall, the nearest relevant USGS stream gauge, distance to gauge, topographic position of gauge, annual mean discharge, high flow, and low flow.

Table 5: Movement of Water

Number of Stream Miles	1,337
Average Stream Gradient (Main Stem)	16 ft/mi
Average Rainfall	45
Nearest Relevant USGS Stream Gauge	03213700 Tug Fork @ Williamson, WV
Distance to Relevant USGS Stream Gauge (mi)	16
USGS Stream Gauge Topographic Position	Upstream
Annual Mean Discharge (cfs)	1,119
High Flow (cfs)	74,000 April 5, 1977
Low Flow (cfs)	56 September 19, 1999

- **Review of Water Quality Data**

In order to characterize the condition of the surface water within the watershed, the available chemical and biological water quality data was reviewed. This data was collected as part of the BPH and the West Virginia Department of Environmental Protection (DEP) implementation of the federal Safe Drinking Water Act and Clean Water Act. Water quality data was evaluated to help provide direct pointers to a source of contamination and to direct the focus for additional source evaluations. Additionally, immediate source water protection efforts will be identified by this review.

Available water quality data includes test results from treated drinking water, finished water, and untreated source water (raw water) conducted by the water supplier; ambient water chemistry; biological criteria and monitoring (bacteria, macroinvertebrates and fish); and habitat evaluation. The sampling requirements for public water systems vary depending on the type of system and the federal regulated testing requirements. Therefore, a lack of water quality impacts may indicate the lack of a certain type of sampling rather than a lack of contamination.

### **Summary of Raw and Finished Water Quality Results from Public Water System**

Water sampling conducted by Mingo County PSD-Naugatuck did not indicate any substantial water quality issues. Chemical constituents of concern identified in a review of water quality test results from the past five years at the intake include sodium and total trihalomethanes. The intake had no maximum contaminant level (MCL) exceedances for the regulated contaminants having a primary and secondary MCL for finished water within the past five years. For additional information on the finished water quality, please review the consumer confidence report for a yearly summary of the water quality.

### **Summary of Chemical and Biological Water Quality Results from the West Virginia DEP**

DEP records indicate there are 520 streams totaling 1,317 miles in the Tug Fork River Watershed. During the reporting period from 1997-1999, 108 streams totaling 528.09 miles were assessed in the Tug Fork River watershed for the 305b report, as a requirement of the federal Clean Water Act. Of the 528.09 stream miles assessed, 51.23 (9.7%) were fully supporting their overall designated uses, 201.09 (38.1%) were fully supporting but threatened, 115.93 (21.9%) were partially supporting, and 159.81 (30.3%) were non-supporting.

Considering major and moderate/minor impacts, the principal causes of impairment in the watershed are Fecal Coliform (223.38 miles), Siltation (209.13 miles), Turbidity (155.00 miles), and Unknown Cause (138.56 miles). A large portion of the stream mileage contributing to these causes is the Tug Fork River mainstem. Considering both major and moderate/minor impacts, the principal sources of pollution in the watershed are Abandoned Mining (188.88 miles), Unknown Source (176.07 miles), and Raw Sewage (165.09 miles).

During this reporting cycle, 472.45 stream miles in the Tug Fork River watershed were monitored for toxics. Of these, 70.59 miles (14.9%) had elevated levels. No streams in the Tug Fork River watershed are currently under a fish consumption advisory. Sixty four streams from the Tug Fork River watershed are on the current 303(d) list, including 1 (Tug Fork River mainstem) on the Primary Waterbody list and 63 on the Mine Drainage Impaired sublist. A TMDL for the Tug Fork river mainstem was finalized in 2002 for total aluminum and total iron. Additionally, TMDL development for total iron, total aluminum, total manganese and pH was finalized in 2002 for numerous tributaries of the Tug Fork River impacted by mine drainage. The Tug Fork River remains on the 303(d) list for biological impairment from mile point 54.2 to its headwaters. Currently, no 303(d) listed streams in the Tug Fork River watershed have had TMDL's completed.

### **Summary of Other Available Chemical and Biological Water Quality Data**

Not Available

## **POTENTIAL SIGNIFICANT CONTAMINANT SOURCES (PSCS'S):**

### **Inventory of Potential Significant Contaminant Sources**

The purpose of providing an inventory of certain types of land uses, potential significant contaminant sources, and activities within the SWAP area is to aid in reducing the risk posed to the public drinking water supply. The following subsections provide information regarding the methodology used to generate the inventories.

The inventory portion of the SWAP consists of two steps:

- The first step is the broad inventory based primarily on regulated and existing databases. The inventory consists of a general land use analysis, the identification of regulated activities in the delineated WSDA areas, and an analysis of road and rail crossings adjacent to the streams in the WSDA area.
- The second step is the detailed inventory of PSCS's in the ZCC. The detailed source inventory is conducted to identify PSCS's that were not captured in the broad regulated source inventory and to field verify the PSCS's in the ZCC. PCS's located during the inventory are found on Figure 2.

A detailed risk-assessment of the PSCS's was beyond the scope of this survey because of minimal data and resources. Local decision makers should do the detailed risk analysis because they are better suited to make the bridge from assessment work to protective strategies. The West Virginia SWAP program can provide guidance to the decision makers and help in prioritizing the PSCS sources.

- **Existing (primarily regulated) Database Review**

Table 6 is a summary of existing PSCS's based on public information obtained from various federal, state, and local agencies that maintain environmental regulatory databases. These databases provide information about the regulatory status of a property and incidents involving use, storage, spilling or transportation of oil, and hazardous materials.

Table 6: Summary of existing (primarily regulated)

	<b>NUMBER</b>	<b>PERCENT</b>
WSDA	5,350	100
ZCC	43	0.8

- **Summary of the Detailed Inventory**

Table 7 is a summary of the detailed inventory of potential contaminant sources in the ZCC. The detailed source inventory was conducted to identify PSCS's that were not identified in the existing database review and to verify the location of the PSCS within the ZCC. Additional PSCSs that were identified in detailed inventories of the ZCC consist of commercial activities (a power station, gas stations and junkyards), and industrial operations (natural gas well and rock yard). Of these PSCSs, some of the industrial sources may have large volumes of potential contaminant stored.

Table 7: Summary of PSCS within the ZCC

<b>Potential Contaminant Source</b>	<b>TOTAL PSCS'S</b>	<b>PERCENT</b>
AGRICULTURE	0	0
RESIDENTIAL	0	0
MUNICIPAL	0	0
COMMERCIAL	10	83
INDUSTRIAL	2	17

- **Transportation Network**

A summary of the transportation network is shown in Table 8. This information can be used to aid in planning for transportation related accidents that could result in contamination of the source water in the delineated WSDA. Table 9 is a summary of the transportation network stream crossings in the WSDA limited to the WV state boundary. Please note that miles of train tracks could be less due to decommissioning of tracks.

Table 8: Transportation Network Summary for WSDA\*

	<b>Within 100 feet of stream</b>	<b>Total</b>
Miles of Interstate		0
Miles of Primary		159
Miles of Secondary		25
Miles of Train Tracks		268

\*This information is limited to the WSDA within the state boundaries of West Virginia.

Table 9: Transportation Network Stream Crossings in the WSDA\*

	<b>Train Tracks</b>	<b>Interstate</b>	<b>Primary Roads</b>	<b>Secondary Roads</b>
Number of Stream Crossings	332	0	96	12

\*This information is limited to the WSDA within the state boundaries of West Virginia.

## • **General Land Use**

The general land use analysis will provide an indication of which land uses predominate throughout the SWAP area, near the intake, or adjacent to the rivers, streams, lakes, and reservoirs. The land use in the SWAP area is shown in Table 10.

Table 10: General Land Use\*

<b>LAND USE</b>	<b>WSDA Area (Acres)</b>	<b>WSDA % of Total</b>	<b>ZCC Area (Acres)</b>	<b>ZCC % of Total</b>
Shrub Land	4,017.62	0.94	104.30	4.75
Woodland	400,942.90	93.36	1,665.98	75.85
Water	2,033.38	0.47	41.14	1.87
Roads	0	0	0	0
Power lines	2,239.55	0.52	0	0
Urban	8,514.29	1.98	232.63	10.59
Agriculture	5,435.18	1.27	12.01	0.55
Barren	6,219.14	1.45	139.44	6.35
Wetland	65.83	0.02	0.89	0.04

\*This information is limited to the WSDA within the state boundaries of West Virginia.

## **SWAPP Area Assessment and Protection Activities**

Analysis of the Resource Characterization and potential significant contaminant sources of the SWAP area for the Bluestone Conference Center indicates that the water supply is susceptible to possible future contamination based on the following:

- ✓ Stream crossings (440 total) provide the opportunity for an accidental release/spill of material to easily get directly into the stream drainage network. Source water protection efforts should be directed toward the establishment of an effective and efficient emergency response plan if one does not currently exist.
- ✓ Current land use practices appear to be having an adverse impact on the ecological health of the Tug Fork Watershed. Of the 528.09 stream miles assessed in the DEP 305(b) report; only 51.23 (9.7%) were fully supporting their overall designated uses. In addition, the health of the Tug Fork may be impacted by a number of regulated and unregulated point and non-point sources in the ZCC and WSDA.



## **Recommendations:**

- ✓ Protection efforts should focus on the collection of additional information on the point and non-point sources present to evaluate the risk;
- ✓ Work with the Department of Health and Human Resources, other state agencies and local officials to make sure your intake is included in local regulations and inspections efforts;
- ✓ Restrict access to the intake area and post the area with Drinking Water Protection Area signs;
- ✓ Address any biological contaminant issues; and
- ✓ Protection options need to be actively considered to further evaluate and manage all potential contaminant sources and the Mingo County PSD-Naugatuck public water supply should place a high priority on protecting its supply source.

## **NEXT STEP – SWAP Protection Plan**

The next step in source water protection planning is to prepare a SWAP protection plan. The SWAP protection plan incorporates this source water delineation assessment report and three additional sections: Contingency Planning, Alternative Sources, and Management Planning.

### **Contingency Planning**

A contingency plan documents the system's planned response to interruption of the source water supply.

### **Alternative Sources**

Information pertaining to alternative water sources focusing on long-term source replacement should the system be required to develop a new source of water due to contamination (or other reasons). This section outlines the most likely sources that can be used as an alternate water source.

### **Management Planning**

Management planning is the most important element of SWAP. The management plan identifies specific activities that will be pursued by the system to protect their water resources. The system will benefit by taking a proactive approach to source water protection in their watersheds. It is anticipated that most of the management effort will focus on coordination with government agencies and periodic surveys of the watersheds. It may be necessary to conduct a limited number of special studies to determine actual risk and consequences for selected contaminant sources. This information may be needed before decisions can be made on management activities.

## **Need additional information?**

Additional information or sources of information can be obtained by calling or visiting the BPH web site at [www.wvdhhr.org/bph/swap](http://www.wvdhhr.org/bph/swap) or phoning 304-558-2981.

## **Glossary:**



Best Management Practices (BMP's) are operational procedures used to prevent or reduce pollution.

Public Water System (PWS) is a system for the provision to the public of pipe water for human consumption, if such system has at least 15 service or regularly serves an average of at least 25 individuals daily at least 60 days of the year.

Water Quality Data is used to help assess both the potential pathogen contamination and other compliance monitoring (Nitrates) parameters associated with public water supply wells.

Potential Significant Contaminant Source (PSCS) is a facility or activity that stores, uses, or produces chemicals or elements, and has the potential to release contaminants identified in the state program within a source water protection area in an amount, which could contribute significantly to the contaminants of the source waters of the public water supply.

***Disclaimer - The coverage's presented in this program are under constant revision as new sites or facilities are added. They may not contain all the potential or existing sites or facilities. The West Virginia Bureau for Public Health is not responsible for the use or interpretation of this information. Please report any inaccuracies on either the map or inventory by phoning 304-558-2981.***

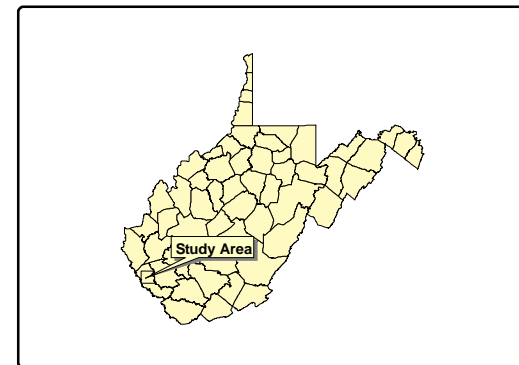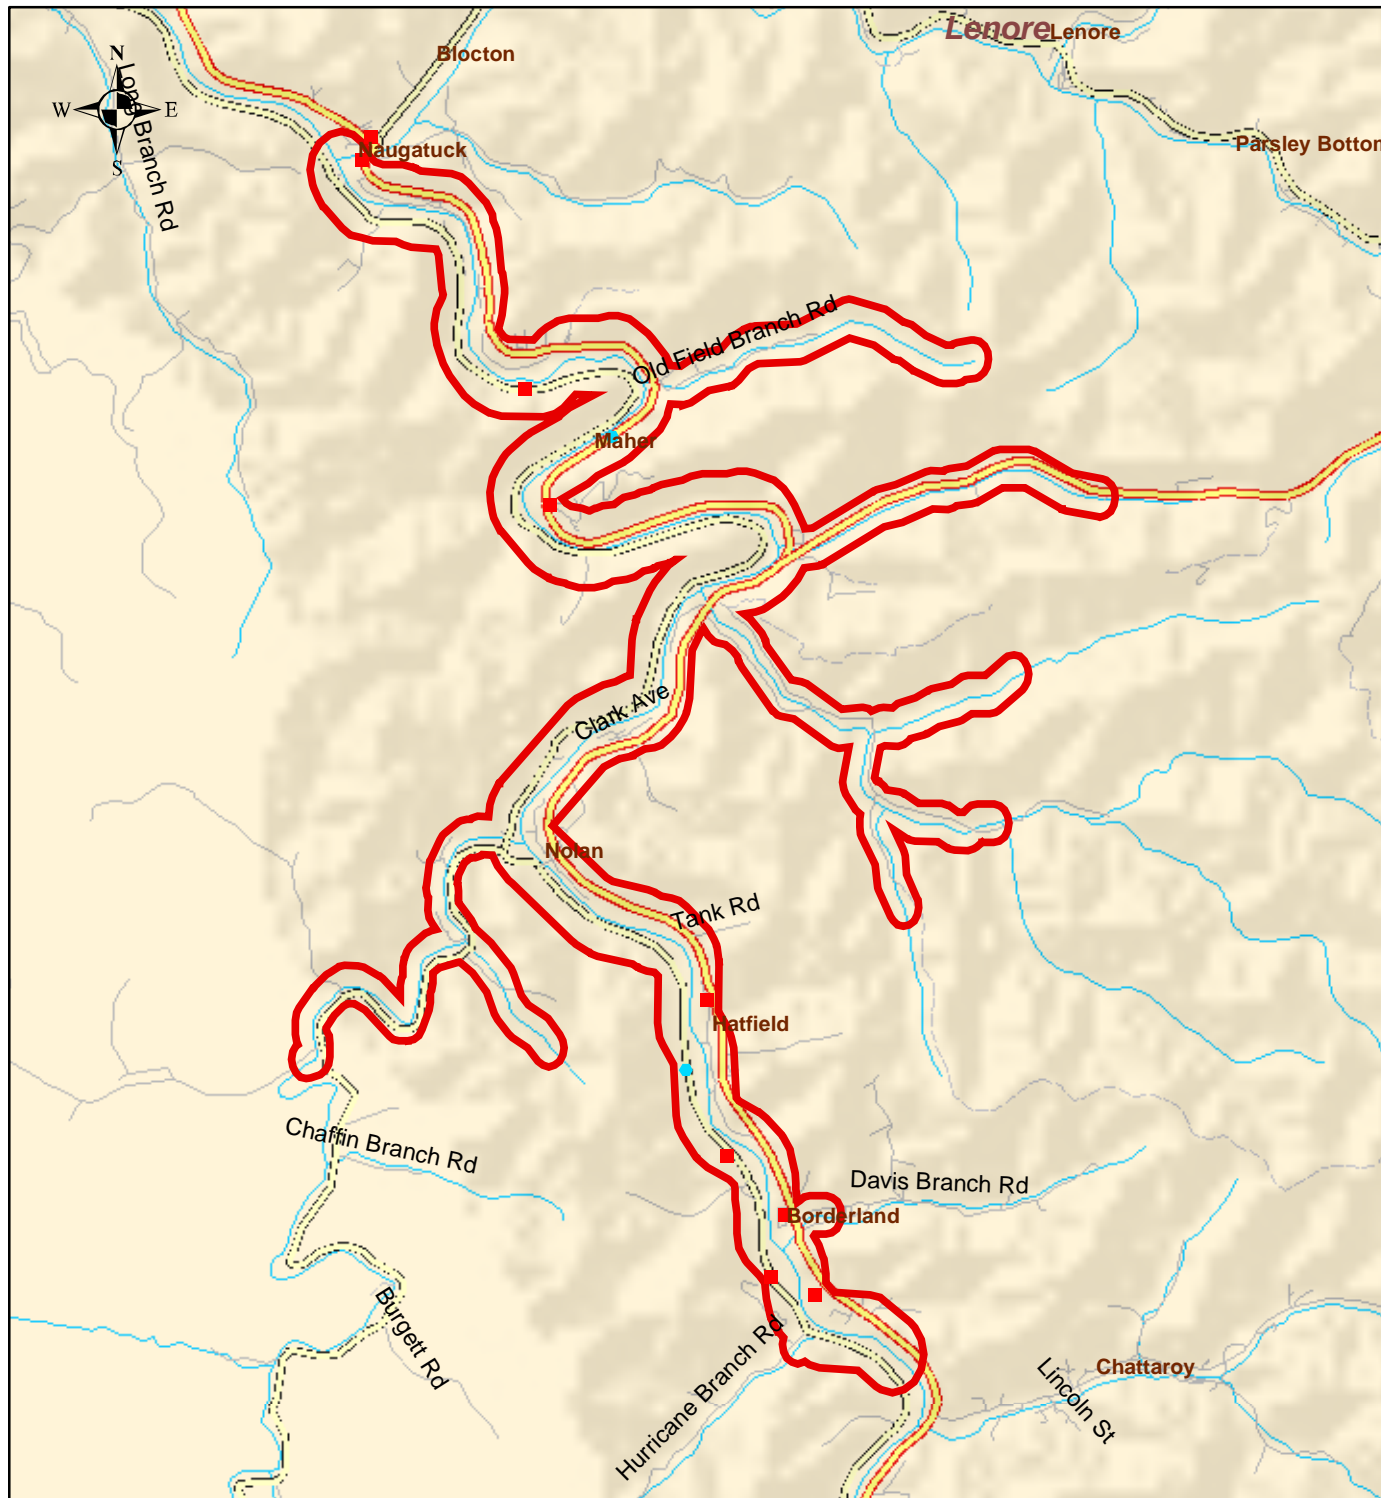

### Map Key

#### Potential Contaminant Sources

- Agriculture
- Commercial
- Industrial
- Municipal
- Residential
- Zone of Critical Concern





This map is provided as a public service by the West Virginia Bureau for Public Health. The Bureau makes NO representation regarding completeness or accuracy of the data hereon. Efforts are made to verify and update the data used to generate this map. However, with data sets of this size and nature, eliminating all errors is difficult. Thus, the user assumes total responsibility for verification.

Source locations not included for reasons of security

## Mingo Co. PSD - Naugatuck Zone of Critical Concern WV3303029 Mingo County

Scale: 1:60,000  
Drawn by: ACS  
09/03/04



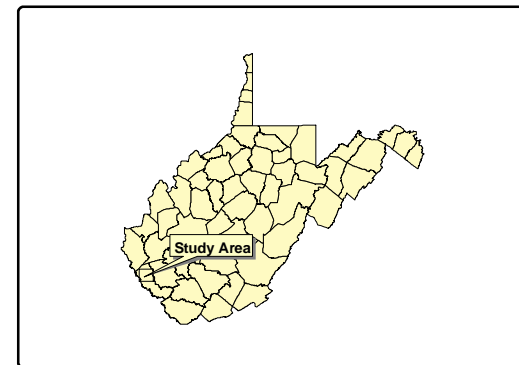

## Map Key

 Watershed Delineation Area



This map is provided as a public service by the West Virginia Bureau for Public Health. The Bureau makes NO representation regarding completeness or accuracy of the data hereon. Efforts are made to verify and update the data used to generate this map. However, with data sets of this size and nature, eliminating all errors is difficult. Thus, the user assumes total responsibility for verification.

Source locations not included for reasons of security

## Mingo Co. PSD - Naugatuck Watershed Delineation Area WV3303029 Mingo County

Scale: 1:640,000  
Drawn by: ACS  
09/03/04

